



DC-9404(IS) Intrinsically Safe Conventional Sounder DC-9403(IS) Intrinsically Safe Conventional Sounder Strobe

Features

- ✧ High bright red LEDs are used as light source.
- ✧ Sound level: 85dB (A weighted, 3m in front).

Description

DC-9404(IS) Intrinsically Safe Conventional Sounder and DC-9403(IS) Intrinsically Safe Conventional Sounder Strobe (hereinafter called the sounder/sounder strobe) is a kind of audible/audible and visual alarm device used to warn people in field when fire occurs. It's applicable to zone 1 and zone 2 of areas with explosion-proof requirement in petroleum and chemical industries. It can match with I-9333 Interface.

Base with 25.5mm high are available.

Connection & Wiring

Terminals on the base are shown in Fig. 2.

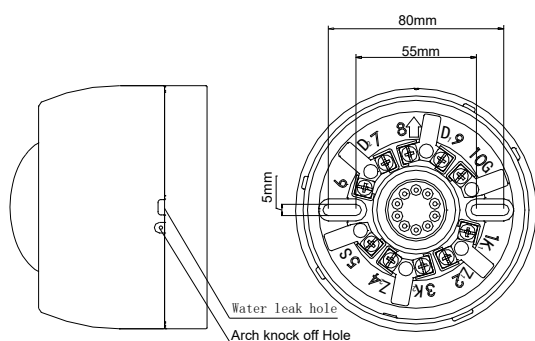


Fig. 1

Fig. 2

D1+ (9), D2- (7): Connected with I-9333 Interface, polarized.

Intrinsic Safety Parameters for D1/D2: $U_i=28V$, $I_i=93mA$, $C_i=0$, $L_i=0$, $P_i=0.65W$

D1 is connected with (3) of the safety barrier and D2 to (4).

Recommended Wiring

Intrinsically safe cable with cross section not less than $1.5mm^2$, subject to local codes.

Installation

Warning: Before installing the device, disconnect the power from the loop.

✧ Before installation, make sure the enclosure is in good condition and marking complete.

✧ When the sounder/sounder strobe is surface mounted, it should be placed 0.2m from the ceiling for normal space height. When conduit is embedded, the base can be mounted on the electrical box. Its mounting method is shown in Fig. 3. Water leak hold should installed downward.

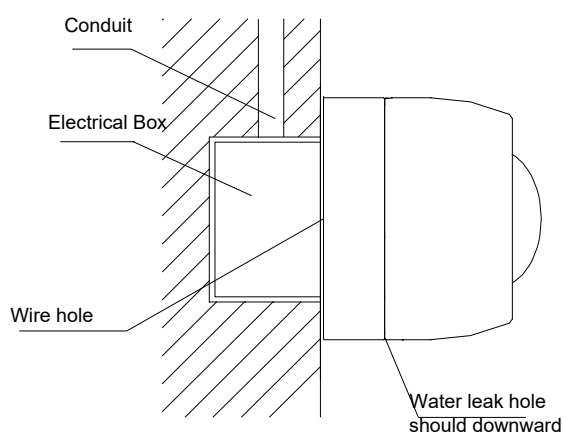


Fig. 3

✧ The base and the sounder/sounder strobe are twisted together. When mounting, remove the sounder strobe, thread cables through the cable entry in the base and connect with corresponding terminals, then twist the sounder/sounder strobe onto the base.

✧ If the sounder/sounder strobe is required anti-removal, knock down the arch knock-off hole as shown in Fig. 1 and fix it with ST2.9×6.5 tapping screws (in this case, it must be removed by a special tool).

Application

The sounder/sounder strobe can match I-9333 Interface to form an intrinsically safe system. The system wiring is shown in Fig. 4.

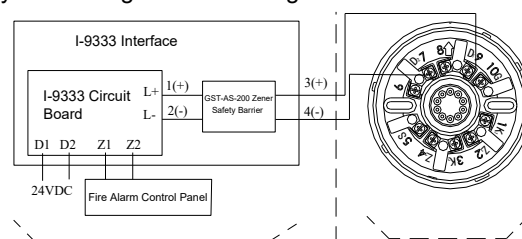


Fig. 4

Cautions

1. I-9333 Interface should be installed in safety area, the wires of "Safety Area" should be separated from those of "Hazardous Area", and be kept a certain distance (at least 50mm).
2. The safety barrier should be well grounded. The screws should not be loose. Ground resistance should not be over 1Ω. The parameters assigned in the intrinsically safe loop should not be over the specified value, that is, the capacity assigned among cables should not be over 0.083μF, the inductance assigned not over 4.1mH.
3. During maintenance, products passing the explosion-proof test should not be replaced and parts and structure affecting explosion-proof functions should not be modified.

Specification

Power Loop voltage when activating	24VDC (16VDC~28VDC)
Power Loop voltage in standby state	7VDC (5VDC~8VDC)
Standby current	≤5mA
Active current	≤50mA
Wiring	Polarized two-wire with I-9333 Interface
Sound Level	Sound level: 85dB~115dB (A weighted in 3m front).
Flashing Frequency	1.4×(1±20%)Hz (DC-9403(IS))
Tone Modification Period	0.7s±20%
Explosion-proof marking	Exib II CT6 Gb
Explosion-proof Certificate Number	CE22.3907 (DC-9404(IS)) CE22.3905 (DC-9403(IS))
Security Barrier Parameters GST-AS-200	U ₀ =28V, I ₀ =93mA
Ingress Protection Rating	IP33
Operating Temperature	-10℃~+55℃
Relative Humidity	≤95%, non condensing
Application	Indoor
Material and Color of Enclosure	ABS, red. 10 ⁷ Ω≤surface resistance≤10 ⁹ Ω, plexiglass in front
Dimension (D×H)	φ110mm×95.9mm
Mounting Hole Spacing	55mm~80mm
Weight	DC-9404(IS): About 312.2g DC-9403(IS): About 322.2g

Limited Warranty

GST will repair or replace the product to the original purchaser free of charge, if defective in materials or workmanship during the warranty period, subject to the terms below. GST and KDSS are not responsible for defects or problems as a result of conditions or applications including normal wear and tear; catastrophe; fault or negligence of any user or any party other than GST and KDSS; improper installation, application, storage, maintenance, or use of products; other causes external to products; or failure to conform to any applicable recommendations of GST and KDSS. In no event shall GST and KDSS be liable for incidental, indirect, special or any other consequential damages. To the fullest extent permissible by law, the foregoing limited warranty is exclusive and in lieu of all other warranties, whether written, oral, implied or statutory. Subject to applicable law, in no event shall the liability of GST and KDSS exceed the purchase price of the products. NO IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR PARTICULAR PURPOSE SHALL APPLY. Anybody, including the agents, distributors or employees, is not in the position to amend the contents of this warranty.

Product warnings and disclaimers

THESE PRODUCTS ARE INTENDED FOR SALE TO AND INSTALLATION BY QUALIFIED PROFESSIONALS. KIDDE GLOBAL SOLUTIONS AND ITS AFFILIATE COMPANIES (TOGETHER AND EACH INDIVIDUALLY "KGS") CANNOT PROVIDE ANY ASSURANCE THAT ANY PERSON OR ENTITY BUYING ITS PRODUCTS, INCLUDING ANY "AUTHORIZED DEALER" OR "AUTHORIZED RESELLER", IS PROPERLY TRAINED OR EXPERIENCED TO CORRECTLY INSTALL FIRE AND SECURITY RELATED PRODUCTS.

For more information on warranty disclaimers and product safety information, please check <https://firesecurityproducts.com/policy/product-warning/> or scan the following code:



This Data Sheet is subject to change without notice. Please contact GST for more information or questions.

Gulf Security Technology Co., Ltd.

No. 80, Changjiang East Road, ETDZ, Qinhuangdao, Hebei, P. R. China 066004

Tel: +86 (0) 335 8502434